

2017 Resource Report for
Town of Hardwick Electric Department

**PO Box 516
Hardwick, VT 05843**

Phone (802) 472-5201
Fax (802) 472-6769

Submitted to:

the Vermont Public Utility Commission
and
the Public Service Department of the State of Vermont

on
February 28, 2018

by
the Vermont Public Power Supply Authority

on behalf of
Town of Hardwick Electric Department

in fulfillment of
Vermont Public Utility Commission Rule 5.206(b)



1) Executive Summary

The Town of Hardwick Electric Department (“Hardwick”) submits the following report to the Vermont Public Utility Commission and the Public Service Department in compliance with Rule 5.206 (B), *Reporting Power Supply Transactions*. The information contained within this report summarizes Hardwick’s power supply needs and acquisition strategy. This report also summarizes resource transactions the utility expects to enter during the next five years.

Hardwick relies on the Vermont Public Power Supply Authority (VPPSA) for its interactions with the Independent System Operator of New England (ISO-NE) and New England power markets. In addition to managing resources in the New England markets VPPSA explores new generation sources for its members.

2) Utility Information

In 2017, Hardwick’s total load requirement was 38,448,096 kWh; this includes RTLO in ISO markets plus known behind-the-meter generation. It reached a peak energy requirement from ISO-NE of 7,031 kW on December 28 at hour ending 18:00. Over the past several years, Hardwick’s load has remained fairly stable and is summarized in the following table.

Year	Load Obligation in New England Market (kWh)	Percent Increase or Decrease
2013*	38,235,182	
2014*	38,240,210	0.00%
2015*	38,093,812	-0.40%
2016	38,492,403	1.00%
2017	38,448,096	-0.10%

NOTE: 2013, 2014 & 2015 loads reflect ISO-NE RTLO; 2016 and 2017 reflect total load (RTLO plus known behind-the-meter generation)

Hardwick’s energy needs are projected into the future by a regression model that uses past load trends, weather, economic forecasts and known customer changes. Updated load forecasts are completed regularly to refine Hardwick’s future energy need estimates. Below is a summary of Hardwick’s forecasted energy requirements from 2018 to 2022.

Year	Total Load Obligation (kWh)	ISO-NE Settlement Load Obligation (kWh)	Percent Increase (Decrease) Total Load
2018	38,640,007	35,451,144	0.50%
2019	38,687,683	35,497,241	0.10%
2020	38,771,351	35,575,098	0.20%
2021	38,822,318	35,622,544	0.10%
2022	38,868,505	35,666,147	0.10%

3) Market Conditions and New England Wholesale Price of Electricity

Wholesale Markets

Since it was restructured in 1999 to implement competitive bidding for electrical power plants, the New England market has experienced increased volatility. Prior to 1999, power plants were self-dispatched based on actual cost and settled after the need for energy had been determined. In May 1999, the New England Wholesale Power Markets were restructured such that plants were centrally dispatched by the Independent System Operator of New England (ISO-NE) and settled based on the forecasted need for energy twelve hours in advance of the operating day. Generators were dispatched in economic order from lowest price to highest until the forecasted energy requirement was met. As a result, competitive market forces guided wholesale prices based on the ongoing balance between supply and demand.


In March 2003, Standard Market Design (“SMD”) was implemented in the New England wholesale markets. Overseen by ISO-NE, this set of rules introduced various clearing points on the New England transmission system (“grid”) with the goal of sending accurate price signals regarding supply and demand at different locations throughout Vermont and New England. Generators are given dispatch instructions one day in advance of the operating day (i.e. “day-ahead”) by matching bid prices (supply) with offers that represent the load needs of utilities (demand). A same-day (i.e. “real-time”) market addresses deviations between day-ahead positions and actual generation

and load requirements within the region. Congestion pricing components help identify constrained areas with inadequate access to wholesale electricity, sending market signals for infrastructure investment through higher wholesale electric prices (alternatively in areas with excess generation, congestion pricing can reduce wholesale market pricing signaling that additional generation in the location is undesirable). These market changes introduced more volatility to energy prices relative to the more regulated electricity markets of the 20th century. This has increased the need for long-term stably-priced power resources to reduce the effects of market swings on ratepayers though it does require careful consideration in locating such resources in relation to the load being served.

In recent history, in most hours natural gas has been the fuel burned by marginal-unit generators in the New England market, resulting in a strong relationship between the prices of natural gas and electrical power. While the United States has experienced a surplus of natural gas supply, the availability of pipeline transportation to New England has become a major constraint. Volatility in recent winter periods can be largely attributed to the restrictions caused by limited-volume natural gas transportation to the New England electricity generation fleet. During the coldest periods, some gas-fired generators have had their generation limited by the lack of fuel available for power production, as natural gas heating customers receive priority deliveries over generators. This has led to increased dispatch of expensive, oil-fired, generation units (or units that normally fire on natural gas but have the ability to switch to oil when natural gas is unavailable) raising the cost of electricity to the region during exceptionally cold periods. A winter reliability program was implemented in winter 2012/13 and ran through winter 2017-18. The program, which was modified from year to year, aimed to address concerns of insufficient fuel on hand in the region when the natural gas system is constrained. The program incentivized generators that could run on oil and liquified natural gas to secure fuel before winter by compensating them. The program resulted in reduced price volatility in the winter but carried a cost of its own. Winter 2017-18 was the last year for the winter program. In June 2018, Pay for Performance (“PFPP”) becomes effective, and has stronger FCM incentives to invest in operational improvements and secure fuel arrangements.


4) Retail Rates in the State of Vermont

The State of Vermont’s average retail rates, as reported by the Department of Energy’s Energy Information Administration (EIA), are currently below the New England average and have remained stable. The following chart shows the average retail electric rates for all sectors in Vermont compared to other New England states. Vermont’s decision not to restructure its electric industry has helped reduce rate volatility and the need for substantial rate increases due to short-term price movement. Customers in Vermont have received significant portions of their power from long-term stably-priced contracts and utility-owned generation while customers in the rest of New England are comparatively exposed to wholesale market price changes. Wholesale electrical power prices reached historic lows in the 2011-12 timeframe, then reached both highs and lows in 2015, illustrating the volatility of the market. The impact of long-term, price-stable resources is apparent in Vermont rates.

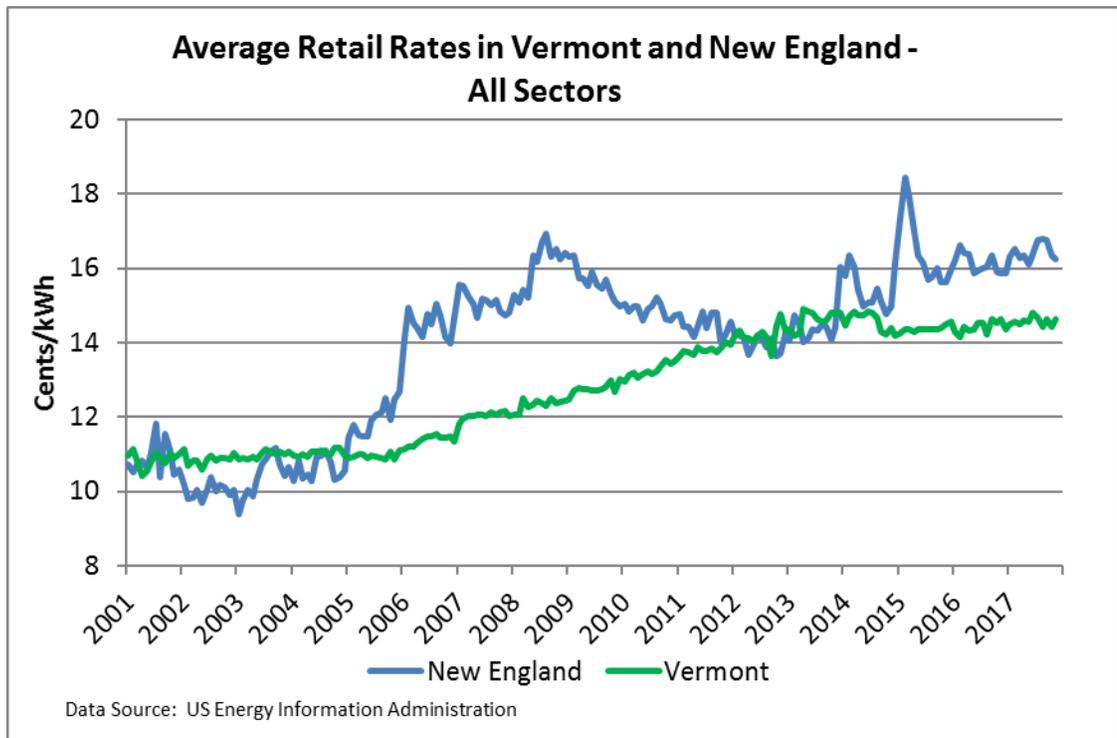


The following chart shows a comparison between the VPPSA member systems and all other Vermont utilities using data from the “kWh and Revenue Report” published

annually by the Vermont Public Service Department. It depicts total reported utility revenue from all classes divided by total reported kWh sales for all classes by year (\$/kWh). VPPSA member systems, as an aggregate, are in the middle of all utilities in the state.

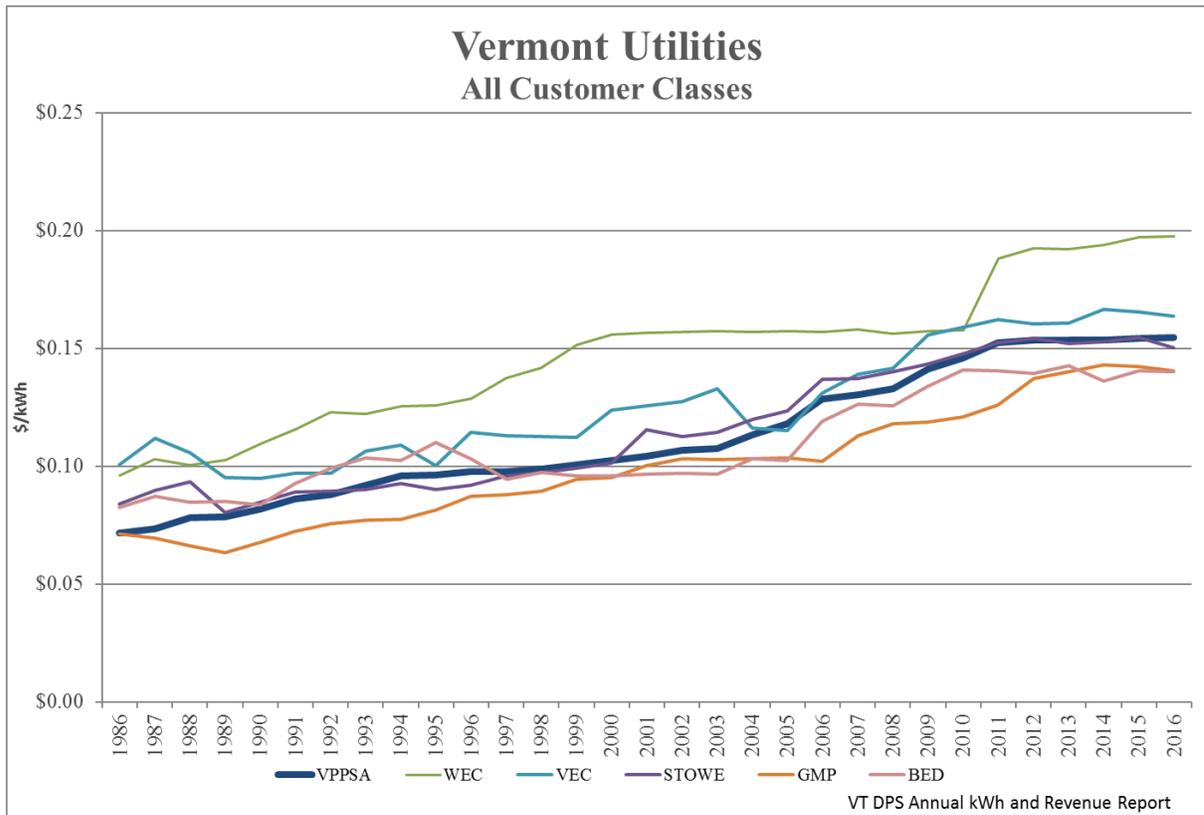

The next chart shows a similar comparison, specifically for residential rate classes between the VPPSA member systems and all other Vermont utilities using data from the “kWh and Revenue Report” published annually by the Vermont Public Service Department. It depicts utility revenue from the residential class divided by reported residential class kWh sales by year (\$/kWh). VPPSA member systems, as an aggregate, are currently the lowest of all utilities in the state. In total, roughly half of VPPSA member systems’ kWh sales are from customers in the residential class.

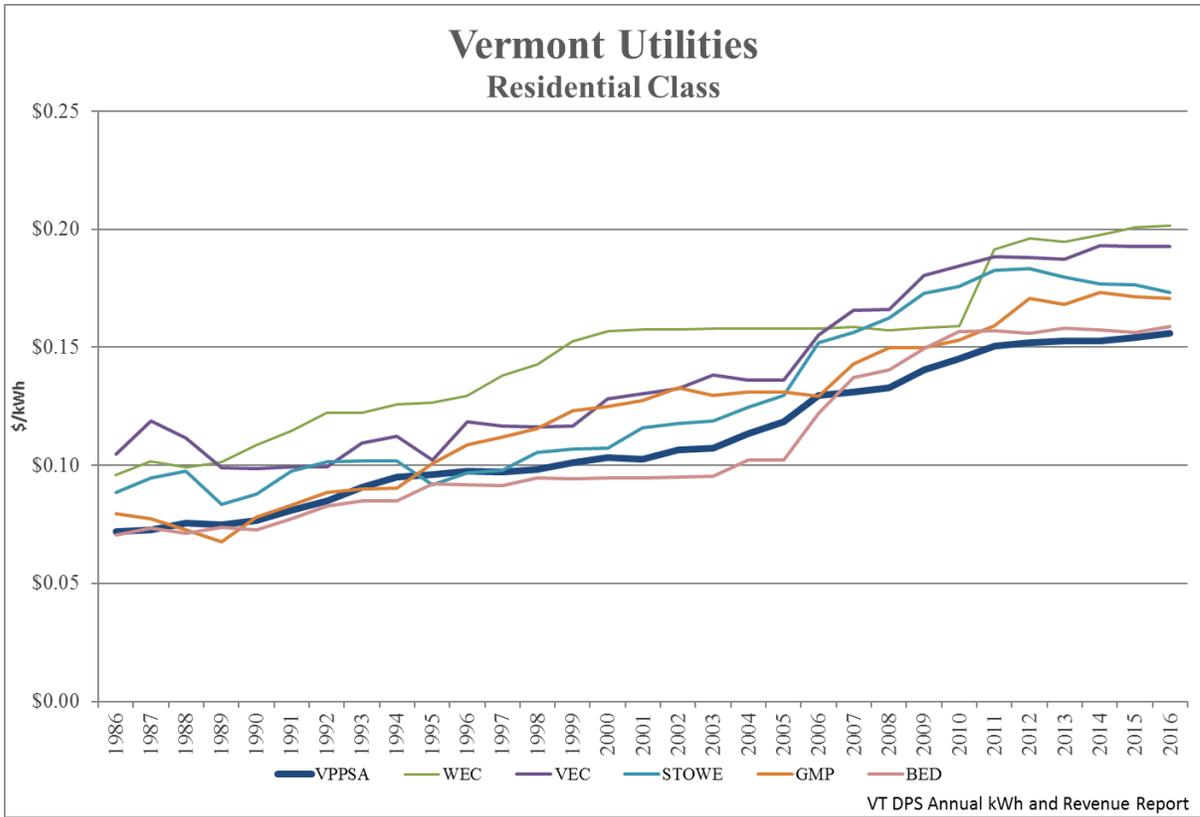

The following tables rank all utilities in the state from highest to lowest Utility Annual Revenue per kWh by rate class for 2016. The VPPSA member systems are listed individually, and in aggregate at the bottom of the table. The data is from the “kWh and Revenue Report” published annually by the Vermont Public Service Department. It is useful to note that many VPPSA systems have mostly residential class customers.

Vermont Utility All Customer Class Revenues Annual Revenues/kWh Sales	
UTILITY	2016 (\$/kWh)
WEC	\$0.1976
BARTON	\$0.1952
HYDE PARK	\$0.1812
HARDWICK	\$0.1773
JOHNSON	\$0.1748
JACKSONVILLE	\$0.1714
VEC	\$0.1636
LUDLOW	\$0.1581
MORRISVILLE	\$0.1568
VPPSA	\$0.1546
LYNDONVILLE	\$0.1538
ENOSBURG FALLS	\$0.1504
STOWE	\$0.1504
ORLEANS	\$0.1427
GMP	\$0.1404
BED	\$0.1402
NORTHFIELD	\$0.1333
SWANTON	\$0.1309
ALL UTILITIES	\$0.1440
VPPSA	\$0.1546

Vermont Utility Total Residential Class Revenues Annual Revenues/kWh Sales	
UTILITY	2016 (\$/kWh)
WEC	\$0.2014
VEC	\$0.1927
BARTON	\$0.1918
HARDWICK	\$0.1786
HYDE PARK	\$0.1782
JOHNSON	\$0.1743
STOWE	\$0.1733
GMP	\$0.1708
JACKSONVILLE	\$0.1699
ENOSBURG FALLS	\$0.1607
BED	\$0.1589
MORRISVILLE	\$0.1573
VPPSA	\$0.1558
LYNDONVILLE	\$0.1554
NORTHFIELD	\$0.1380
LUDLOW	\$0.1351
ORLEANS	\$0.1298
SWANTON	\$0.1288
ALL UTILITIES	\$0.1723
VPPSA	\$0.1558

Vermont Utility Total Commercial and Industrial Class Annual Revenues/kWh Sales	
UTILITY	2016 (\$/kWh)
BARTON	\$0.2072
HYDE PARK	\$0.1901
JOHNSON	\$0.1752
JACKSONVILLE	\$0.1751
HARDWICK	\$0.1741
WEC	\$0.1710
LUDLOW	\$0.1699
MORRISVILLE	\$0.1564
VPPSA	\$0.1535
LYNDONVILLE	\$0.1522
ORLEANS	\$0.1486
STOWE	\$0.1410
ENOSBURG FALLS	\$0.1390
BURLINGTON	\$0.1342
VEC	\$0.1339
SWANTON	\$0.1330
NORTHFIELD	\$0.1305
GMP	\$0.1238
ALL UTILITIES	\$0.1271
VPPSA	\$0.1535

VT DPS Annual kWh and Revenue Report

Utilities in Vermont have dramatically different customer class percentages within their systems resulting in significant variations in load shape. This variation in class is largely responsible for the discrepancies that can be seen in the prior tables. The table below lists the class percentage of total sales by system with the VPPSA member systems listed individually, and in aggregate at the bottom of the table. The data is from the “kWh and Revenue Report” published annually by the Vermont Public Service Department.


Vermont Utility Total Residential Class	
Residential Class kWh Sales /Total	
UTILITY	2016 (%)
WEC	87%
BARTON	78%
HYDE PARK	74%
JACKSONVILLE	71%
HARDWICK	71%
LYNDONVILLE	51%
ENOSBURG FALLS	53%
VEC	50%
VPPSA	50%
SWANTON	49%
MORRISVILLE	47%
JOHNSON	42%
LUDLOW	34%
GMP	35%
NORTHFIELD	38%
ORLEANS	31%
STOWE	29%
BURLINGTON	24%
ALL UTILITIES	37%
VPPSA	50%

Vermont Utility Total Commercial and Industrial Class	
C&I Class kWh Sales /Total	
UTILITY	2016 (%)
WEC	13%
BARTON	22%
HYDE PARK	26%
JACKSONVILLE	29%
HARDWICK	29%
ENOSBURG FALLS	47%
LYNDONVILLE	49%
VEC	50%
VPPSA	50%
SWANTON	51%
MORRISVILLE	53%
JOHNSON	58%
NORTHFIELD	62%
GMP	65%
LUDLOW	66%
ORLEANS	69%
STOWE	71%
BURLINGTON	76%
ALL UTILITIES	63%
VPPSA	50%

VT DPS Annual kWh and Revenue Report

5) Existing Resources

Hardwick’s power supply portfolio is made up of owned generation resources, long-term contracts, and short-term contracts. The diversified portfolio is a hedge for the cost of serving load at the Vermont Zone in the ISO-NE market system. Hardwick’s 2017 fuel mix is summarized in the following chart. Additional information is provided in the table that follows. A brief description of each resource concludes this section.

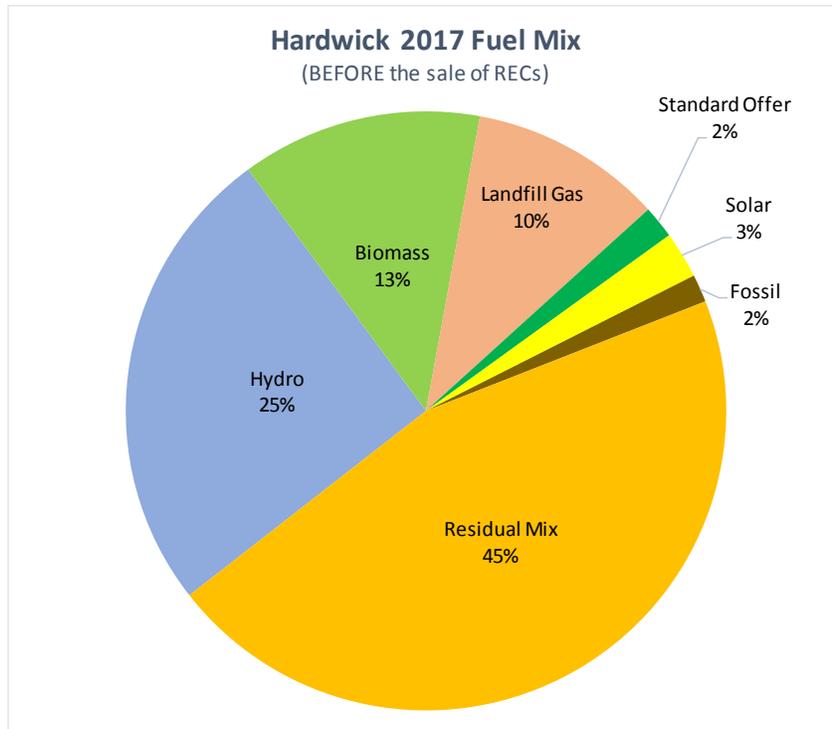

Resource	2017 Max Qualified Capacity	2017 kWh	Type	Description	Fuel	Location	Expiration
J.C. McNeil	796	3,964,702	On Peak	Wood Unit	Wood	Essex Node	Life of Unit
NYPA	610	4,578,154	ATC	Block Power	Hydro	Roseton Interface	Varies
VEPPI- Hydro	92	859,354	Varies	PURPA Units	Hydro	Various VT nodes	Varies
Ryegate	127	1,057,325	Baseload	PURPA contract	Wood	UN.BARRE_VT34.5RYGT	10/31/2021
Stonybrook	1,817	505,875	Peaker	Dispatched	Natural Gas or Fuel Oil	Stonybrk115	Life of Unit
Fitchburg Landfill	506	3,989,026	ATC	Landfill Gas	Landfill Gas	Ashbrnm115	2026 (extendable to 2031)
P10	4,636	57,115	Peaker	Dispatched	Fuel Oil	UN.HIGHGATE13.8SWC1	Life of Unit
Standard Offer	7	677,732	Varies	In-State Renewable	Various Renewable	Varies	Varies
Chester Solar	339	972,418	Solar	Out-of State Solar	Solar	Blandford115	2039
Market Contracts	N/A	17,715,807	Daily	ISO-NE bilateral	System Mix	Mass Hub	Varies from 2009-2017

J. C. McNeil

The McNeil wood-fired generating facility is located in Burlington, Vermont. The facility has a maximum generating capability of 54 MW(winter) and 52 MW (summer). Hardwick’s ownership entitlement to McNeil is provided through an agreement with the Vermont Public Power Supply Authority for the life of the power plant. Hardwick expects the generation to be composed of wood, but natural gas is available as an alternate fuel source (to full output) and for startup. Oil is also available (to a maximum 15 MW output) and is used primarily as a startup fuel.

New York Power Authority (NYPA)

The New York Power Authority provides hydroelectric power to the utilities in Vermont under two contracts. The first contract is a 1 MW entitlement to the Robert Moses Project (a.k.a. “St. Lawrence”) located in Massena, New York. The second contract, known as the “Niagara Contract,” is for a 14.3 MW entitlement to the Niagara Project located at Niagara Falls, New York. The contract for St. Lawrence has been extended through April 30, 2032. The Niagara Contract has been extended through September 1, 2025.

Vermont Electric Power Producers, Inc. (VEPP Inc.)

Hardwick receives power from several independent power producers (IPP) as mandated by Rule 4.100 appointed purchasing agent. Vermont Electric Power Producers, Inc. (VEPP Inc.) assigns power to all Vermont utilities under Vermont Public Utility Commission (PSB) Rule 4.100 based on a pro-rata share of electric sales, updated annually. Contracts between VEPP Inc. and its constituent power producers began to terminate in 2008, with the last contract scheduled to end in 2020 (i.e. by the end of the period covered by this report).

Ryegate Biomass

Barton receives power from Ryegate biomass facility through a state mandated arrangement administered by the State appointed purchasing agent. Vermont Electric

Power Producers, Inc. (VEPP Inc.) assigns power to all Vermont utilities based on a pro-rata share of electric sales which is updated annually. The contract expires 10/31/2021.

Stony Brook Combined Cycle Facility

Hardwick holds an entitlement to Stony Brook. The Stony Brook facility is made up of three a dual-fuel generating units and is located in Massachusetts. While this facility has the capability of generating electricity from fuel oil, natural gas is the primary source of fuel. During winter, the facility's generation is a mix of natural gas and oil due to the inability to fully procure natural gas for peak periods.

Fitchburg Landfill

Hardwick holds an allotment of 11.30% through a 15-year contract for the output of a landfill gas-fired generation facility at Fitchburg Landfill in Westminister, MA. Beginning in 2012, the contract provides nine participating VPPSA members with 3 MW of firm energy, capacity and renewable attributes for 5 years. Beginning in 2017 for the following 5 years, the contract increases to 3MW of firm energy, capacity and renewable attributes plus 1.5MW of unit contingent energy, capacity and renewable attributes. In the final 5 years, the participants will receive 4.5MW of unit contingent energy, capacity and renewable attributes. The contract includes an option to extend deliveries for 4.5MW of unit contingent energy for an additional five years (years 16-20).

Project 10

Hardwick held a municipal vote to authorize the execution of a Power Sales Agreement (PSA) with Vermont Public Power Supply Authority for 9.70% of a 40 MW peaking facility constructed in Swanton, Vermont. Eleven municipal utilities and one Vermont cooperative have signed Purchase Sales Agreements for the project which came online in 2010. Project 10 has benefited significantly from stronger New England capacity prices beginning in June 2017.

The project constructed 46 MW of fast-start generation capacity designed to provide reliability services to the participating municipal utilities at prices below projected New England market prices over the life of the facility. Additionally, the

facility runs during peak price times to mitigate price spikes that occur when New England loads reach peak levels in the summer and winter.

Standard Offer

Hardwick receives power from dozens of independent power producers according to the state mandate set forth in the Vermont Energy Act of 2009 (i.e. Act 45) which is administered by the Sustainably Priced Energy Enterprise Development (SPEED) facilitator. The prices paid to developers under Act 45 were initially standardized based on the type of renewable energy technology; however, in April 2013 the SPEED facilitator implemented a price-based Request for Proposals for developers of Standard Offers projects. Hardwick receives a share of all Standard Offer contracts based on its pro rata share of Vermont's prior-year kWh retail sales. The duration of standard offer contracts is permitted to be between 10 and 20 years except for solar which may be contract for up to 25 years.

Chester Solar

Hardwick holds an allotment of 15.10% in a 4.8 MW solar facility in Chester, Massachusetts. The facility began commercial operation in June 2014. The contract purchases all of the energy and capacity from the facility on a unit contingent basis for a period of 25 years. Renewable energy credits are not included.


Market Purchases

Hardwick meets the remainder of its load obligations through ISO-NE's day-ahead and real-time energy markets, physical bilateral transactions, and financial transactions. Hardwick participates in the wholesale markets based on its forecasted energy requirements. Short-term transactions are made periodically to adjust the portfolio in an effort to match resources to Hardwick's load obligations. Market purchases range in size, duration, and counterparty. Market purchases longer than five years in duration or above certain quantities of historic peak load require Vermont Public Utility Commission approval.

6) Market Position


Energy

Energy is the largest component of a utility's power costs. Presented below is a chart of Hardwick's projected energy resources available from existing contracts and generating plants relative to the monthly forecast of load from 2018 through 2022.

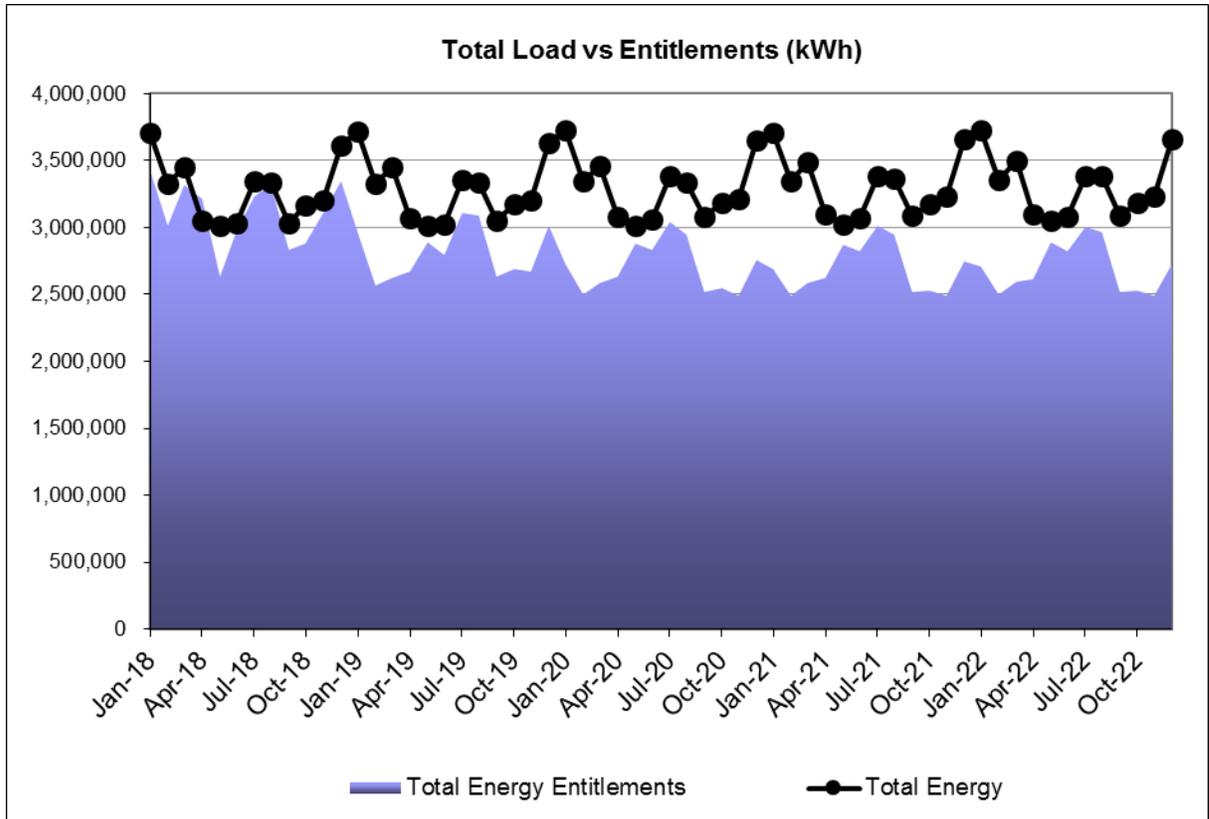

Note the relationship between forecasted energy needs and Hardwick's power supply resources. Gaps represent an under (or over) commitment of power resources as compared to projected load on a monthly basis. As supply falls below load Hardwick will acquire new resources that meet the utility's decision making-criteria.

VPPSA continually evaluates power markets on Hardwick's behalf for economical solutions to address future energy needs. VPPSA and Hardwick seek to diversify the portfolio fuel mixture and to employ renewable solutions whenever possible. The graph below shows Hardwick's generation outlook by fuel type over the next 20 years.

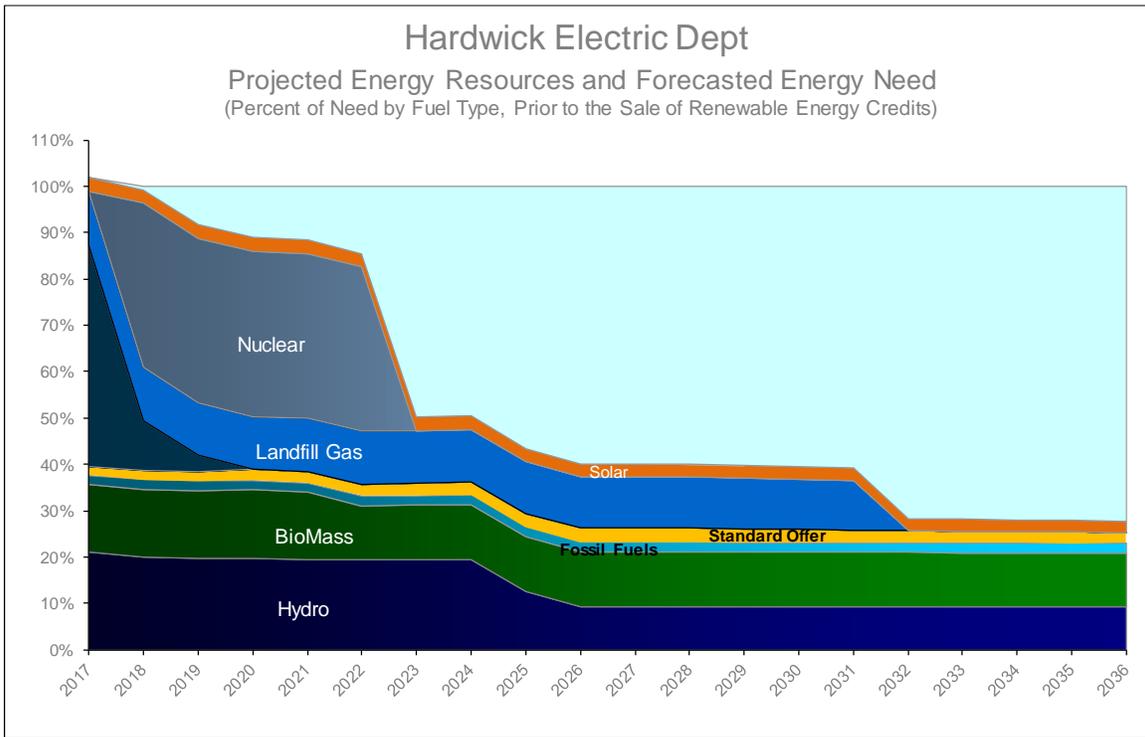


7) Capacity Position

Capacity

Capacity is another major cost driver in a utility’s power costs. Capacity represents the capability to generate electricity and is required for utilities that purchase wholesale electricity in the New England market.

The graph below shows Hardwick’s capacity available from existing resources compared to its projected capacity requirements as a participant in ISO-NE wholesale markets. “Capacity Load Obligation” represents the forecasted amount of capacity Hardwick will be obligated to procure. The chart may not fully capture the impacts of removing the hydro plant from the ISO-NE markets.

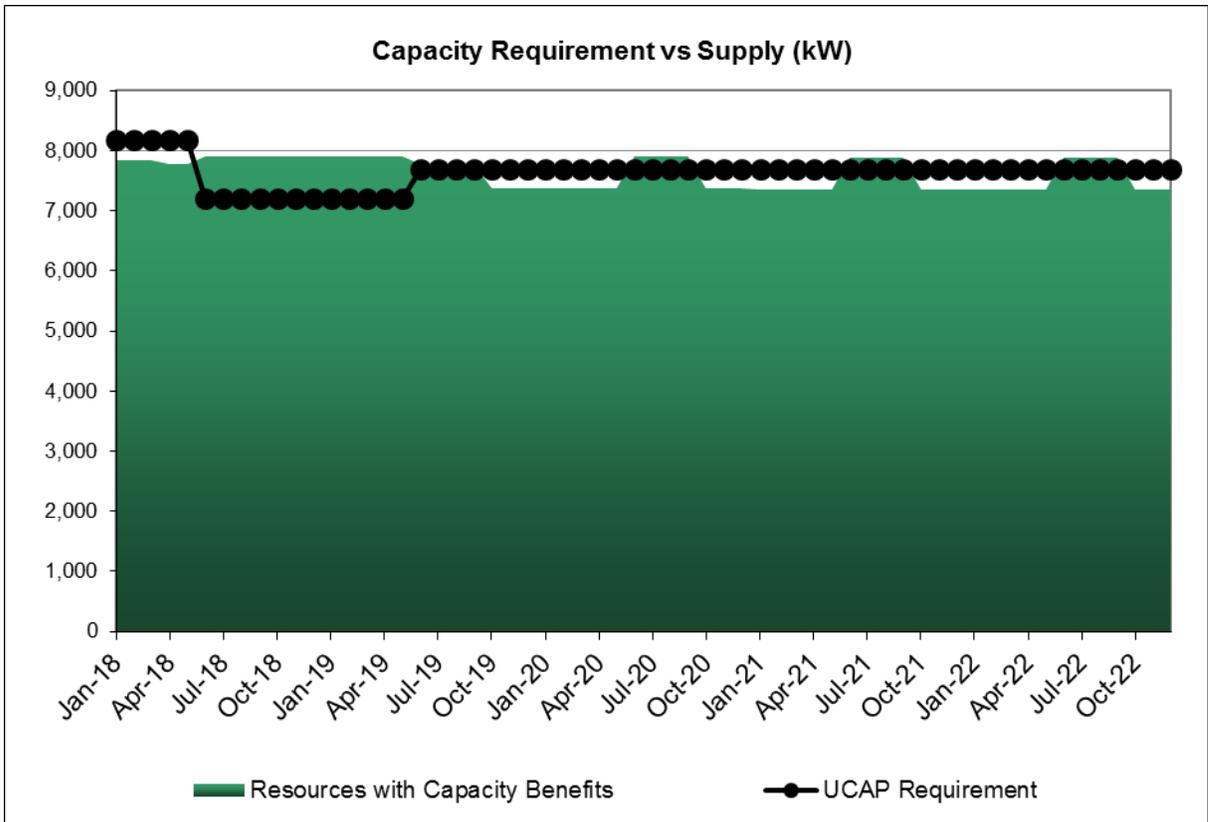

Forward Capacity Market

The Forward Capacity Market (FCM), which became active in 2010, is a market designed to ensure the region has sufficient capacity to meet its peak demand.

Hardwick’s market capacity resources are credited the auction clearing price for the commitment period. Conversely, as a load serving entity, Hardwick will be charged based on its peak contribution (load at the time of New England’s annual peak). The peak contribution is then grossed up by a “reserve margin” to determine the Capacity Requirement. Any load reducing resources that are not participating in the ISO-NE market have the effect of reducing the utility’s Capacity Requirement.

Forward Capacity Auctions (FCA) are held annually to procure capacity three years in advance of the need for capacity. Procurement amounts are based on the forecasted need for capacity during the period for which the auction is held. Capacity resources to which Hardwick is entitled via ownership or contract have generally been offered and accepted in each capacity auction, resulting in a Capacity Supply Obligation (CSO) for each auction commitment period. Hardwick has used this cleared capacity to

help offset its CLO and Capacity Requirement.

The first Forward Capacity Auction took place in February 2008, for capacity year 2010-2011. The results from this auction set a new price for capacity for the period June 2010 to May 2011 (capacity cleared at the administratively set floor price of \$4.50 kW-mo in the first auction). Subsequent auctions have been held for capacity periods through 2018. The table below summarizes clearing prices obtained in the auction process.

Auction	Clearing Price
FCA #1 (2010-11)	\$4.50/kW-mo.
FCA #2 (2011-12)	\$3.60/kW-mo.
FCA #3 (2012-13)	\$2.95/kW-mo.
FCA #4 (2013-14)	\$2.95/kW-mo.
FCA #5 (2014-15)	\$2.21/kW-mo.
FCA #6 (2015-16)	\$3.43/kW-mo.
FCA #7 (2016-17)	\$3.15/kW-mo.
FCA #8 (2017-18)	\$7.03/kW-mo.
FCA #9 (2018-19)	\$9.55/kW-mo.
FCA #10 (2019-20)	\$7.03/kW-mo.
FCA #11 (2020-21)	\$5.30/kW-mo.
FCA #12 (2021-22)	\$4.63/kW-mo.

The capacity market rules have continually changed since its inception. The implementation of administratively set prices, methods for setting the amount of solicited capacity, and participation for renewable resources, are just three examples of the types of fundamental pieces of the market that have changed since the start of the FCM. Effective June 2018, PFP will be in place to incentivize capacity resource owners to make investments to ensure their resources reliability during periods of scarcity. Additionally, ISO-NE has recently proposed further changes to address methods by which state-sponsored policy resources can participate in the markets. On Hardwick's behalf VPPSA monitors and participates in market design and evaluates the utility's capacity position on an ongoing basis.

8) Future Long-Term Resources

VPPSA assists Hardwick in evaluating resources to replace any existing long-term resources or fill any long-term need. At this time VPPSA has negotiated for the purchase of output from power projects that are in the planning and development stages as well as other long term contractual opportunities. Details on successfully contracted resources with future start dates are included below.

2018-2022 Market Purchase

Hardwick participated in a recent transaction to purchase power in the years 2018-2022. The contract provides energy at fixed pricing for the five-year term. This purchase will help Hardwick maintain stable, predictable power supply costs through 2022.

Solar Generation

VPPSA is investigating several avenues to offer VPPSA members an opportunity to purchase power produced by solar units located in Vermont. In 2017, VPPSA issued a request for proposals soliciting proposals from solar developers for facilities ranging from 1-5MW within VPPSA Member territories. In-state solar generation is expected to help VPPSA's members cover daily load profiles, promote the development of renewable generation at the community level, and meet Renewable Energy Standard (RES) requirements.

9) Anticipated Resource Transactions

Planned Purchasing

In order to make its members' power costs more predictable, VPPSA implements a plan to purchase power using a systematic technique, helping to avoid uncertainty and volatile price swings. Hardwick currently participates in the Planned Purchasing structure through its membership in VPPSA. Under the Planned Purchasing approach VPPSA

reviews Hardwick's market exposure at six-month intervals, for two-year forward periods (defined as its forecasted need for power, less amounts available through previously secured long-term contracts and generation).

Periodically, Hardwick has the opportunity to purchase a portion of its energy needs for future periods. By staggering purchases Hardwick's energy needs are met at any given point by contracts purchased at several different times, resulting in less volatile purchased power prices. As a result of this laddering effect, the utility is expected to avoid large breaks in coverage in the immediate future.

The implementation of Planned Purchasing is structured and systematic, but it does not remove the need for continual market monitoring and judgment. The goal is to use market monitoring and judgment to give the municipal systems the benefit of more favorable resource prices. In the event that market prices are below that which would cause rate pressure, longer duration purchases may be made. In the event that unusually high prices prevail at the time of a planned purchase, the purchase may be delayed.